




Powder Coated Colour To Be Advised
 Aluminium Construction
 Galvinised Plinth
 All Compartment Doors To Be CL001 and Padlockable
 All Unmetered Parts To Be Padlockable To Supply
 Authority Requirements
 All Circuit Breaker Sections Have Escutcheons
 18kA Form 2B

1 - 8x 1Ø + 4x 3Ø 63A Outgoing Circuit Breakers
 2 - 1x 3Ø 250A Incoming Supply Meter Panel Isolator
 3 - 2x 3Ø 125A Circuit Breaker Panel Isolators

a - NE-NB10
 b - NE-CB-63/3/C
 c - NE-EB12
 d - NE-HRC100
 e - NE-NB12
 f - NE-ISO250
 g - NE-CB125-3-125

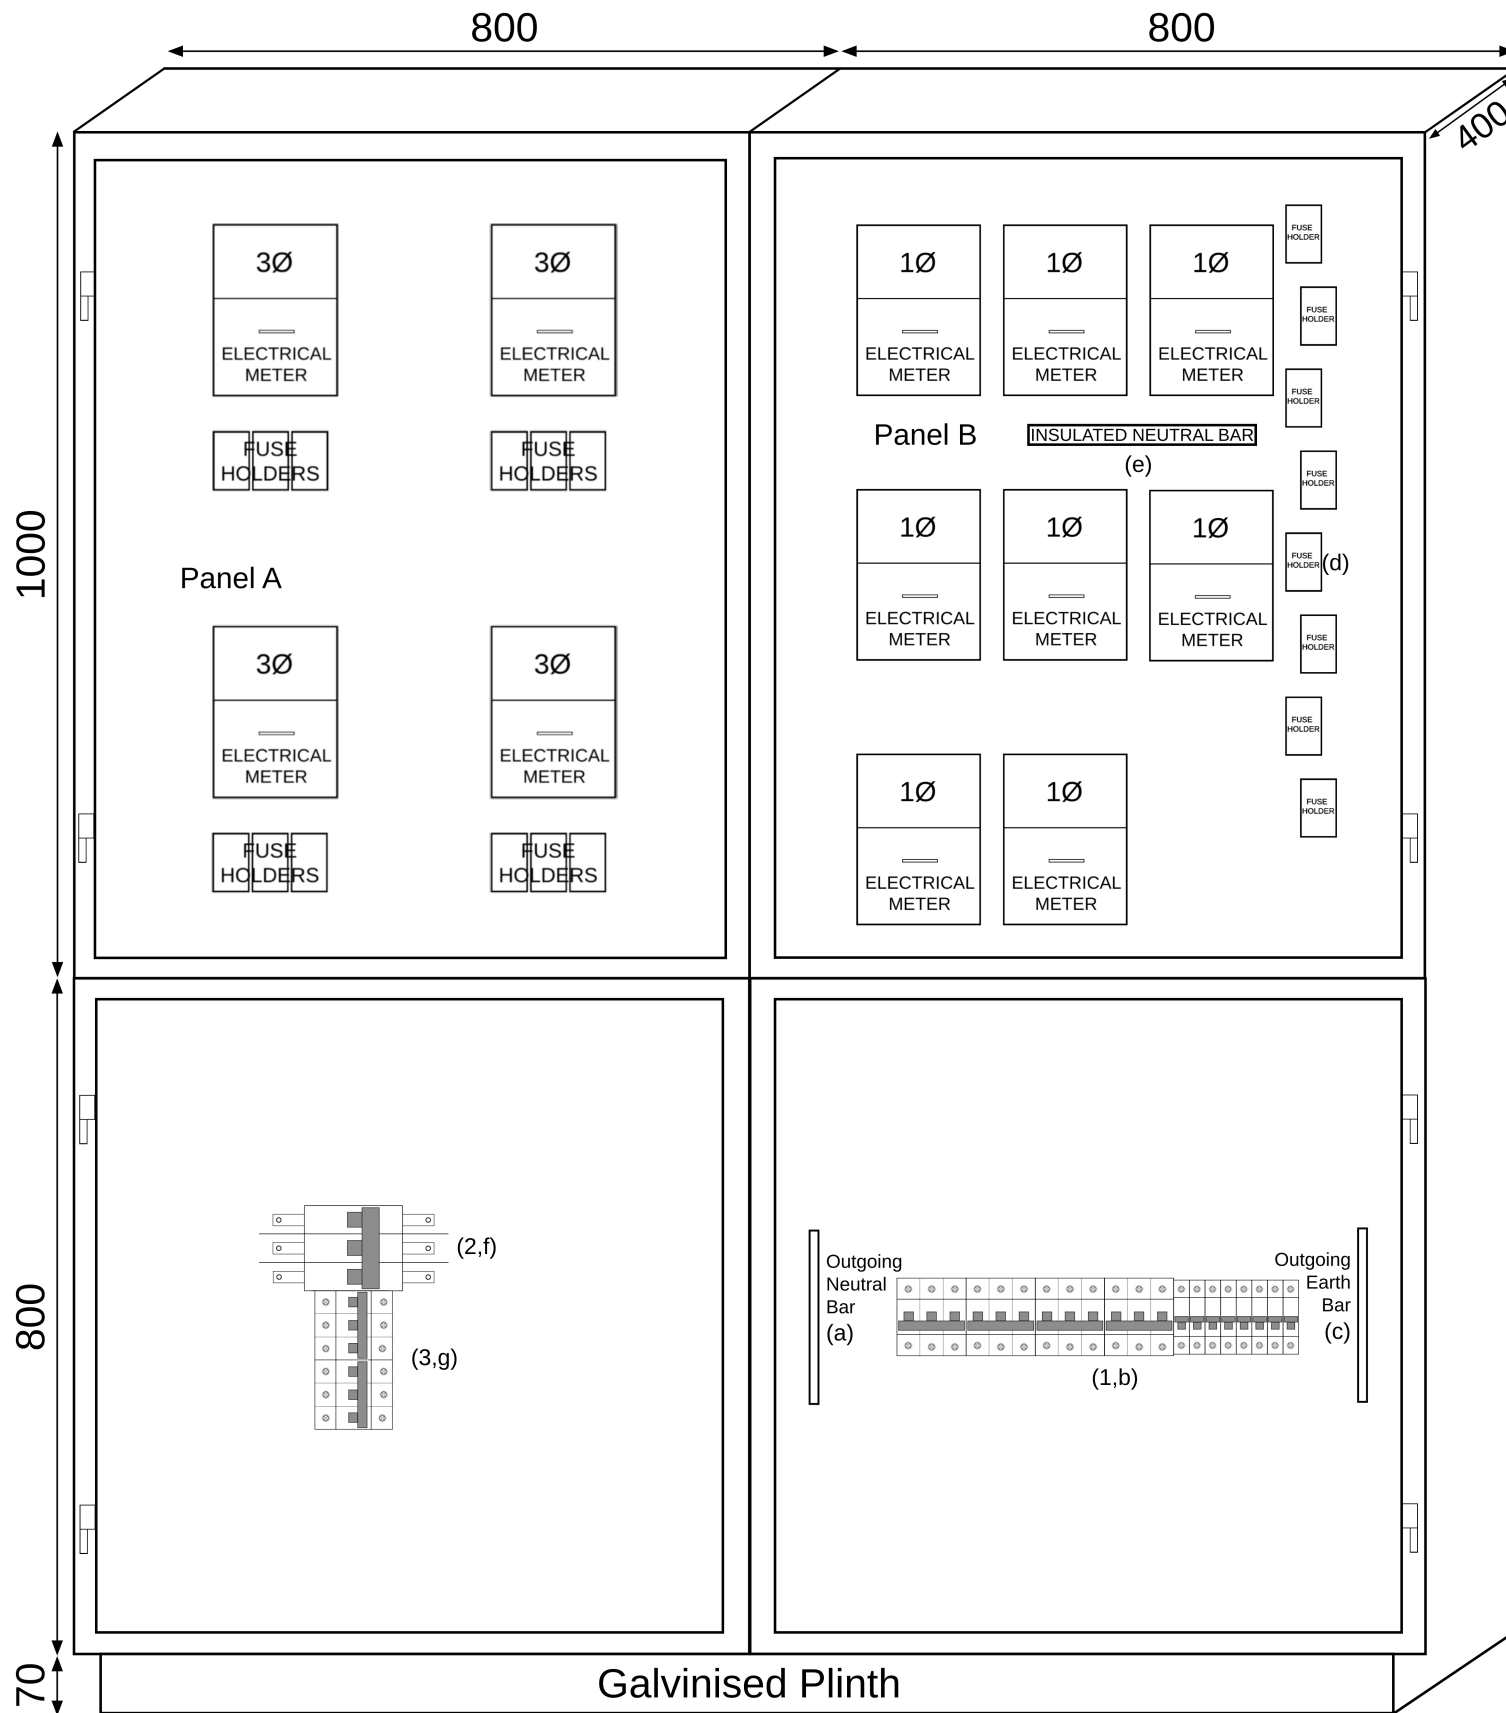